SIEMENS

Data sheet

3RA2417-8XF31-2AF0

Contactor assembly for star-delta (wye-delta) start AC-3, 11 kW/400 V, 110 V AC 50/60 Hz, 3-pole, Size S00 Spring-type terminals electrical and mechanical interlock 3 NO integrated



| product brand name | SIRIUS | | |
|--|---|--|--|
| product designation | Contactor assembly for star-delta (wye-delta) start | | |
| product type designation | 3RA24 | | |
| manufacturer's article number | | | |
| 1 of the supplied contactor | <u>3RT2018-2AF01</u> | | |
| 2 of the supplied contactor | <u>3RT2018-2AF01</u> | | |
| 3 of the supplied contactor | <u>3RT2016-2AF01</u> | | |
| of the supplied RS assembly kit | <u>3RA2913-2BB2</u> | | |
| of the supplied function module for wye-delta circuits | <u>3RA2816-0EW20</u> | | |
| General technical data | | | |
| size of contactor | S00 | | |
| product extension auxiliary switch | No | | |
| shock resistance at rectangular impulse | | | |
| • at AC | 7,3g / 5 ms, 4,7g / 10 ms | | |
| • at DC | 7.3g / 5 ms, 4.7g / 10 ms | | |
| shock resistance with sine pulse | | | |
| • at AC | 11,4g / 5 ms, 7,3g / 10 ms | | |
| • at DC | 11,4g / 5 ms, 7,3g / 10 ms | | |
| mechanical service life (operating cycles) | | | |
| of contactor typical | 10 000 000 | | |
| of the contactor with added auxiliary switch block typical | 10 000 000 | | |
| reference code according to IEC 81346-2 | Q | | |
| Substance Prohibitance (Date) | 10/01/2009 | | |
| Ambient conditions | | | |
| installation altitude at height above sea level maximum | 2 000 m | | |
| ambient temperature | | | |
| during operation | -25 +60 °C | | |
| during storage | -55 +80 °C | | |
| Main circuit | | | |
| number of poles for main current circuit | 3 | | |
| number of NO contacts for main contacts | 3 | | |
| number of NC contacts for main contacts | 0 | | |
| operating voltage | | | |
| at AC-3 rated value maximum | 690 V | | |
| operational current | | | |
| ● at AC-3 | | | |
| — at 400 V rated value | 25 A | | |
| operating power | | | |
| ● at AC-3 | | | |
| — at 400 V rated value | 11 kW | | |

| — at 500 V rated value | 11 kW |
|--|--|
| — at 690 V rated value | 11 kW |
| operating frequency | |
| • at AC-3 maximum | 1 000 1/h |
| Control circuit/ Control | |
| type of voltage of the control supply voltage | AC |
| control supply voltage 1 at AC | |
| • at 50 Hz rated value | 110 V |
| • at 60 Hz rated value | 110 V |
| operating range factor control supply voltage rated value of magnet coil at AC | |
| • at 50 Hz | 0.8 1.1 |
| • at 60 Hz | 0.85 1.1 |
| apparent pick-up power of magnet coil at AC | |
| ● at 50 Hz | 76 VA |
| • at 60 Hz | 68 VA |
| inductive power factor with closing power of the coil | |
| • at 50 Hz | 0.8 |
| • at 60 Hz | 0.75 |
| apparent holding power of magnet coil at AC | 40.4144 |
| • at 50 Hz | 13.4 VA |
| • at 60 Hz | 10.8 VA |
| inductive power factor with the holding power of the coil | 0.25 |
| • at 50 Hz • at 60 Hz | 0.25 |
| Auxiliary circuit | 0.20 |
| number of NO contacts for auxiliary contacts | |
| instantaneous contact | 3 |
| contact reliability of auxiliary contacts | < 1 error per 100 million operating cycles |
| UL/CSA ratings | |
| contact rating of auxiliary contacts according to UL | A600 / Q600 |
| | |
| Short-circuit protection | |
| Short-circuit protection design of the fuse link | |
| Short-circuit protection design of the fuse link • for short-circuit protection of the main circuit | |
| design of the fuse link | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 50 A |
| design of the fuse link • for short-circuit protection of the main circuit | |
| design of the fuse link for short-circuit protection of the main circuit — with type of coordination 1 required | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 50 A gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A |
| design of the fuse link for short-circuit protection of the main circuit with type of coordination 1 required with type of assignment 2 required | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A |
| design of the fuse link for short-circuit protection of the main circuit with type of coordination 1 required with type of assignment 2 required for short-circuit protection of the auxiliary switch required | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and |
| design of the fuse link for short-circuit protection of the main circuit with type of coordination 1 required with type of assignment 2 required for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 0 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — upwards — downwards — at the side | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — upwards — downwards — at the side • for grounded parts | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — upwards — at the side • for grounded parts — forwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — at the side • for grounded parts — forwards — backwards — backwards — backwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 0 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — upwards — downwards — at the side • for grounded parts — forwards — upwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — upwards — downwards — at the side • for grounded parts — forwards — upwards — at the side • for grounded parts — at the side | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit — with type of coordination 1 required — with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — upwards — downwards — at the side • for grounded parts — upwards — upwards — backwards — upwards — downwards — at the side — downwards — upwards — downwards — at the side — downwards — at the side — downwards — at the side — downwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit with type of coordination 1 required with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting - forwards - upwards - downwards - at the side • for grounded parts - upwards - upwards - backwards - upwards - forwards - backwards - ownwards - forwards - forwards - forwards - heide • for grounded parts - forwards - at the side - downwards - ownwards - for live parts | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit with type of coordination 1 required with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting - forwards - backwards - upwards - at the side • for grounded parts - forwards - backwards - upwards - backwards - forwards - heide • for grounded parts - forwards - at the side - downwards - for live parts - forwards - forwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| design of the fuse link • for short-circuit protection of the main circuit with type of coordination 1 required with type of assignment 2 required • for short-circuit protection of the auxiliary switch required Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting - forwards - upwards - downwards - at the side • for grounded parts - forwards - upwards - downwards - at the side - forwards - odwnwards - odwnwards - odwnwards - odwnwards - odwnwards - odwnwards | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 25 A fuse gG: 10 A +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm DIN rail 84 mm 135 mm 145 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |

| - downward | ls | | 6 mm | | |
|---|--|----------------------------|-------------------------------|--|-------------------------------|
| — at the side | | 6 mm | | | |
| Connections/ Terminals | | | 0 mm | | |
| type of electrical con | | | | | |
| for main current | | | spring-loaded terminals | | |
| | | | | | |
| for auxiliary and control circuit | | spring-loaded terminals | | | |
| at contactor for auxiliary contacts | | Spring-type terminals | | | |
| of magnet coil | | Spring-type terminals | | | |
| type of connectable conductor cross-sections for main contacts | | | | | |
| • solid | | | 2x (0.5 4 mm²) | | |
| solid or stranded | | 2x (0,5 4 mm²) | | | |
| finely stranded with core end processing | | 2x (0.5 2.5 mm²) | | | |
| finely stranded without core end processing | | | 2x (0.5 2.5 mm²) | | |
| •• | conductor cross-section | ns | | | |
| for auxiliary con | ntacts | | | | |
| — solid or str | randed | | 2x (0.5 2.5 mm²) | | |
| finely strar | nded with core end proce | ssing | 2x (0.5 1.5 mm²) | | |
| — finely strar | nded without core end pro | cessing | 2x (0.5 1.5 mm²) | | |
| for AWG cables | s for auxiliary contacts | | 2x (20 14) | | |
| Safety related data | | | | | |
| B10 value with high de | emand rate according to S | 3N 31920 | 1 000 000 | | |
| proportion of danger | rous failures | | | | |
| | d rate according to SN 3 ² | 920 | 40 % | | |
| | nd rate according to SN 3 | | 75 % | | |
| | | | 100 FIT | | |
| failure rate [FIT] with low demand rate according to SN 31920 T1 value for proof test interval or service life according to IEC 61508 | | 20 a | | | |
| | n the front according to | IEC 60529 | IP20 | | |
| - | the front according to I | | finger-safe, for vertical cor | stact from the front | |
| Communication/ Proto | | .0 00323 | | | |
| | | | Ne | | |
| product function bus communication | | No | | | |
| protocol is supported AS-Interface protocol | | No | | | |
| product function control circuit interface with IO link | | No | | | |
| Certificates/ approvals | 3 | | | | |
| General Product App | proval | Declaration of | Conformity | Test Certificates | |
| Oraclination | | | | Turne Test Ostifie | |
| Confirmation | FAL | () | UK | <u>Type Test Certific-</u> ates/Test Report | Special Test Certific- ate |
| | LIIL | EG-Konf. | UK CA | | _ |
| Marine / Shipping | LIIL | EG-Konf. | CA | | |
| Marine / Shipping | LIIL | EG-Konf. | CA | | |
| Marine / Shipping | LIIL | EG-Konf. | Lloyds Register | | |
| Marine / Shipping | | EG-Konf. | | PRS | RINA |
| Marine / Shipping | LIIL BUREAU VERITAS | EG-Konf. | Lloyds Register | PRS | RINA |
| ABS | | | Lloyds Register uis | PRS | RINA |
| Marine / Shipping | E B B B B B C C C C C C C C C C | Railway | Lloyds Register uis | PRS | RINA |
| Marine / Shipping | E B B B B B C C C C C C C C C C | Railway Vibration and S | Lloyds Register uis | PRS | RINA |

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

https://support.industry.siemens.com/cs/ww/en/view/109813875 Information- and Downloadcenter (Catalogs, Brochures,...) https://www.siemens.com/ic10

Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RA2417-8XF31-2AF0

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RA2417-8XF31-2AF0

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

https://support.industry.siemens.com/cs/ww/en/ps/3RA2417-8XF31-2AF0

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RA2417-8XF31-2AF0&lang=en


Characteristic: Tripping characteristics, I²t, Let-through current


https://support.industry.siemens.com/cs/ww/en/ps/3RA2417-8XF31-2AF0/char


Further characteristics (e.g. electrical endurance, switching frequency)

http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=

| | 135 |
|----|---|
| | |
| 84 | |
| Ĩ | U SUBMERS SRUS ^{U U} SUBMERS SRUS ^{U U} SUBMERS SRUS ^U |
| | 2 3 4 5 2 3 4 5 2 3 4 5 |
| | |



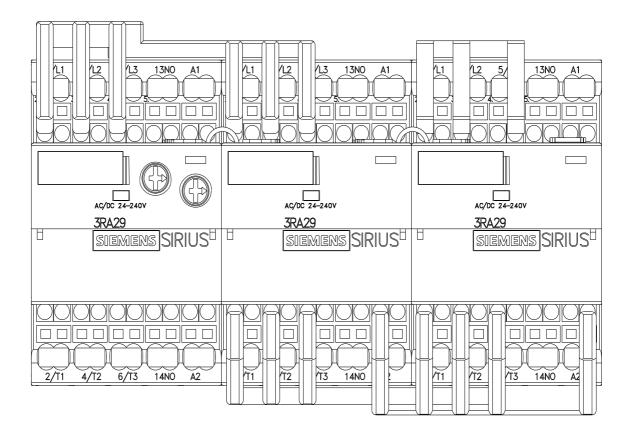

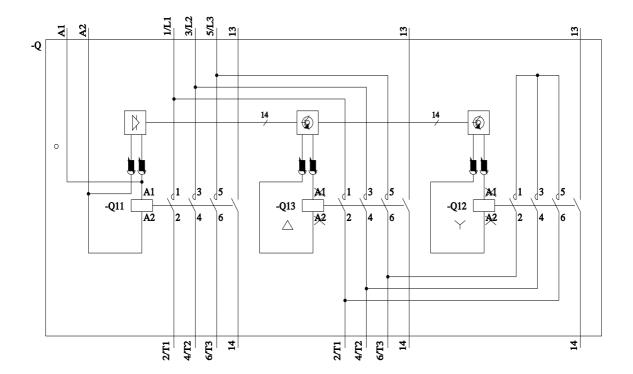

last modified:

11/21/2022 🖸

7/18/2023