SIEMENS

Data sheet

3RT2038-3AC20



power contactor, AC-3e/AC-3, 80 A, 37 kW / 400 V, 3-pole, 24 V AC, 50/60 Hz, auxiliary contacts: 1 NO + 1 NC, main circuit: screw terminal, control and auxiliary circuit: spring-loaded terminal, size: S2

product brand name	SIRIUS
product designation	Power contactor
product type designation	3RT2
General technical data	
size of contactor	S2
product extension	
 function module for communication 	No
auxiliary switch	Yes
power loss [W] for rated value of the current	
 at AC in hot operating state 	17.1 W
 at AC in hot operating state per pole 	5.7 W
 without load current share typical 	17.2 W
insulation voltage	
 of main circuit with degree of pollution 3 rated value 	690 V
 of auxiliary circuit with degree of pollution 3 rated value 	690 V
surge voltage resistance	
 of main circuit rated value 	6 kV
 of auxiliary circuit rated value 	6 kV
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V
shock resistance at rectangular impulse	
• at AC	11.8g / 5 ms, 7.4g / 10 ms
shock resistance with sine pulse	
• at AC	18.5g / 5 ms, 11.6g / 10 ms
mechanical service life (operating cycles)	
 of contactor typical 	10 000 000
 of the contactor with added electronically optimized auxiliary switch block typical 	5 000 000
 of the contactor with added auxiliary switch block typical 	10 000 000
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2014
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
during operation	-25 +60 °C
during storage	-55 +80 °C
relative humidity minimum	10 %
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %
Main circuit	
number of poles for main current circuit	3

number of NO contacts for main contacts	3
operating voltage	
at AC-3 rated value maximum	690 V
 at AC-3e rated value maximum 	690 V
operational current	
• at AC-1 at 400 V at ambient temperature 40 °C rated	90 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated value	90 A
— up to 690 V at ambient temperature 60 °C rated	80 A
value	
• at AC-3	
— at 400 V rated value	80 A
— at 500 V rated value	80 A
— at 690 V rated value	58 A
• at AC-3e	
— at 400 V rated value	80 A
— at 500 V rated value	80 A
— at 690 V rated value	58 A
at AC-4 at 400 V rated value	55 A
at AC-5a up to 690 V rated value	79.2 A
 at AC-5b up to 400 V rated value at AC-6a 	66.4 A
	70 A
— up to 230 V for current peak value n=20 rated value	
 — up to 400 V for current peak value n=20 rated value — up to 500 V for current peak value n=20 rated value 	70 A 70 A
— up to 500 V for current peak value n=20 rated value	58 A
• at AC-6a	50 A
 up to 230 V for current peak value n=30 rated value 	46.7 A
— up to 200 V for current peak value n=30 rated value	46.7 A
— up to 500 V for current peak value n=30 rated value	46.7 A
— up to 690 V for current peak value n=30 rated value	46.7 A
minimum cross-section in main circuit at maximum AC-1 rated	35 mm ²
value	
operational current for approx. 200000 operating cycles at AC-4	
at 400 V rated value	30 A
at 690 V rated value	24 A
operational current	
• at 1 current path at DC-1	
— at 24 V rated value	55 A
— at 60 V rated value	23 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
• with 2 current paths in series at DC-1	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	45 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
 with 3 current paths in series at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	45 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
 at 1 current path at DC-3 at DC-5 	

— at 24 V rated value	35 A				
— at 60 V rated value	6 A				
— at 220 V rated value	1 A				
— at 440 V rated value	0.1 A				
— at 600 V rated value	0.06 A				
 with 2 current paths in series at DC-3 at DC-5 					
— at 24 V rated value	55 A				
— at 60 V rated value	45 A				
— at 110 V rated value	45 A 25 A				
— at 220 V rated value					
	5 A 0 27 A				
— at 440 V rated value	0.27 A				
— at 600 V rated value	0.16 A				
• with 3 current paths in series at DC-3 at DC-5					
— at 24 V rated value	55 A				
— at 60 V rated value	55 A				
— at 110 V rated value	55 A				
— at 220 V rated value	25 A				
— at 440 V rated value	0.6 A				
— at 600 V rated value	0.35 A				
operating power					
• at AC-2 at 400 V rated value	37 kW				
• at AC-3					
— at 230 V rated value	22 kW				
— at 400 V rated value	37 kW				
— at 500 V rated value	37 kW				
— at 690 V rated value	45 kW				
• at AC-3e					
- at 230 V rated value	22 kW				
— at 400 V rated value	37 kW				
— at 500 V rated value	37 kW				
— at 690 V rated value	45 kW				
operating power for approx. 200000 operating cycles at AC- 4					
at 400 V rated value	15.8 kW				
at 690 V rated value	21.8 kW				
operating apparent power at AC-6a	07.0 10/4				
	27.8 kVA				
• up to 230 V for current peak value n=20 rated value					
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value 	48.4 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value 	60.6 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 					
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value 	60.6 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	60.6 kVA				
up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a	60.6 kVA 69.3 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value Operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for surrent peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value n=30 rated value up to 690 V for current p	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC 	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 ra	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating freque	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC-1 maximum at AC-	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h 500 1/h				
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h 500 1/h				


type of voltage of the control supply voltage	AC
control supply voltage at AC	
• at 50 Hz rated value	24 V
• at 60 Hz rated value	24 V
operating range factor control supply voltage rated value of magnet coil at AC	
• at 50 Hz	0.8 1.1
• at 60 Hz	0.85 1.1
apparent pick-up power of magnet coil at AC	
• at 50 Hz	210 VA
• at 60 Hz	188 VA
inductive power factor with closing power of the coil	
• at 50 Hz	0.69
• at 60 Hz	0.65
apparent holding power of magnet coil at AC	
• at 50 Hz	17.2 VA
• at 60 Hz	16.5 VA
inductive power factor with the holding power of the coil	
• at 50 Hz	0.36
• at 60 Hz	0.39
closing delay	
• at AC	10 80 ms
opening delay	
• at AC	10 18 ms
arcing time	10 20 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous	1
contact	
number of NO contacts for auxiliary contacts instantaneous contact	1
operational current at AC-12 maximum	10 A
operational current at AC-15	
• at 230 V rated value	10 A
• at 400 V rated value	3 A
● at 500 V rated value	2 A
• at 690 V rated value	1 A
operational current at DC-12	
operational current at DC-12 o at 24 V rated value	10 A
-	10 A 6 A
• at 24 V rated value	
at 24 V rated valueat 48 V rated value	6 A
 at 24 V rated value at 48 V rated value at 60 V rated value 	6 A 6 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value 	6 A 6 A 3 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value 	6 A 6 A 3 A 2 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value 	6 A 6 A 3 A 2 A 1 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value 	6 A 6 A 3 A 2 A 1 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value Operational current at DC-13	6 A 6 A 3 A 2 A 1 A 0.15 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value operational current at DC-13 at 24 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 24 V rated value at 24 V rated value at 48 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 24 V rated value at 48 V rated value at 60 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value operational current at DC-13 at 24 V rated value at 48 V rated value at 60 V rated value at 60 V rated value at 60 V rated value at 110 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 1 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value operational current at DC-13 at 24 V rated value at 48 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 110 V rated value at 110 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 1 A 0.9 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value operational current at DC-13 at 24 V rated value at 48 V rated value at 60 V rated value at 60 V rated value at 110 V rated value at 110 V rated value at 125 V rated value at 125 V rated value at 125 V rated value at 220 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 48 V rated value at 48 V rated value at 60 V rated value at 60 V rated value at 110 V rated value at 220 V rated value at 24 V rated value at 25 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 220 V rated value at 600 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 48 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 220 V rated value at 60 V rated value at 220 V rated value at 60 V rated value at 125 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 110 V rated value at 110 V rated value at 220 V rated value at 600 V rated value at 125 V rated value at 125 V rated value at 220 V rated value at 600 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 110 V rated value at 125 V rated value at 600 V rated value at	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA)
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 24 V rated value at 24 V rated value at 48 V rated value at 60 V rated value at 60 V rated value at 110 V rated value at 220 V rated value at 60 V rated value at 125 V rated value at 125 V rated value at 125 V rated value at 220 V rated value at 220 V rated value at 220 V rated value at 480 V rated value at 480 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 65 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 48 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 220 V rated value at 60 V rated value at 60 V rated value at 125 V rated value at 125 V rated value at 125 V rated value at 220 V rated value at 600 V rated value at 600 V rated value at 600 V rated value at 480 V rated value at 480 V rated value at 600 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 65 A
 at 24 V rated value at 48 V rated value at 60 V rated value at 110 V rated value at 125 V rated value at 220 V rated value at 600 V rated value operational current at DC-13 at 24 V rated value at 60 V rated value at 60 V rated value at 110 V rated value at 110 V rated value at 220 V rated value at 220 V rated value at 48 V rated value at 60 V rated value at 60 V rated value at 125 V rated value at 220 V rated value at 220 V rated value at 220 V rated value at 600 V rated value at 480 V rated value at 600 V rated value 	6 A 6 A 3 A 2 A 1 A 0.15 A 10 A 2 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 65 A


— at 230 V rated value	15 hp			
• for 3-phase AC motor				
— at 200/208 V rated value	20 hp			
— at 220/230 V rated value	25 hp			
— at 460/480 V rated value	50 hp			
— at 575/600 V rated value	60 hp			
contact rating of auxiliary contacts according to UL	A600 / P600			
hort-circuit protection				
design of the fuse link				
 for short-circuit protection of the main circuit 				
— with type of coordination 1 required	gG: 250 A (690 V, 100 kA), aM: 160 A (690 V, 100 kA), BS88: 200 A (415 V, 8 kA)			
 — with type of assignment 2 required 	gG: 160A (690V,100kA), aM: 80A (690V,100kA), BS88: 125A (415V,80kA)			
 for short-circuit protection of the auxiliary switch required 	gG: 10 A (500 V, 1 kA)			
nstallation/ mounting/ dimensions				
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface			
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715			
side-by-side mounting	Yes			
height	114 mm			
width	55 mm			
depth	130 mm			
required spacing				
with side-by-side mounting				
— forwards	10 mm			
— upwards	10 mm			
— downwards	10 mm			
— at the side	0 mm			
for grounded parts	0 mm			
- forwards	10 mm			
— upwards	10 mm			
— at the side	6 mm			
— downwards	10 mm			
• for live parts	10			
— forwards	10 mm			
— upwards	10 mm			
— downwards	10 mm			
— at the side	6 mm			
connections/ Terminals				
type of electrical connection				
 for main current circuit 	screw-type terminals			
 for auxiliary and control circuit 	spring-loaded terminals			
 at contactor for auxiliary contacts 	Spring-type terminals			
 of magnet coil 	Spring-type terminals			
type of connectable conductor cross-sections for main contacts				
 solid or stranded 	2x (1 35 mm²), 1x (1 50 mm²)			
 finely stranded with core end processing 	2x (1 25 mm²), 1x (1 35 mm²)			
connectable conductor cross-section for main contacts				
 finely stranded with core end processing 	1 35 mm²			
connectable conductor cross-section for auxiliary contacts				
	0.5 2.5 mm²			
 solid or stranded 				
 solid or stranded finely stranded with core end processing 	0.5 1.5 mm²			
	0.5 1.5 mm² 0.5 2.5 mm²			
• finely stranded with core end processing				
finely stranded with core end processingfinely stranded without core end processing				
 finely stranded with core end processing finely stranded without core end processing type of connectable conductor cross-sections 				
 finely stranded with core end processing finely stranded without core end processing type of connectable conductor cross-sections for auxiliary contacts 	0.5 2.5 mm²			
 finely stranded with core end processing finely stranded without core end processing type of connectable conductor cross-sections for auxiliary contacts — solid or stranded 	0.5 2.5 mm² 2x (0.5 2.5 mm²)			
 finely stranded with core end processing finely stranded without core end processing type of connectable conductor cross-sections for auxiliary contacts — solid or stranded — finely stranded with core end processing 	0.5 2.5 mm ² 2x (0.5 2.5 mm ²) 2x (0.5 1.5 mm ²)			

for main contactsfor auxiliary cont		18 1 20 14					
Safety related data			20				
product function		_					
•	ccording to IEC 60947-4-1		Yes				
	-		No				
	• positively driven operation according to IEC 60947-5-1 B10 value with high demand rate according to SN 31920		1 000 000				
proportion of danger		151920	1 000 000				
		20	40 %				
	I rate according to SN 319 d rate according to SN 319		73 %				
	Ű						
	w demand rate according		100 FIT				
61508	interval or service life acco	raing to IEC	20 a				
protection class IP or	the front according to II	EC 60529	IP20				
-	he front according to IEC		finger-safe, for vertical contact from the front				
suitability for use	..						
 safety-related sw 	vitching OFF		Yes				
Certificates/ approvals			105				
General Product App	roval						
(SP)		<u>Confirmation</u>		KC	EHC		
EMC	Functional Safety/Safety of Ma- chinery	Declaration of Co	onformity	Test Certificates			
RCM	<u>Type Examination Cer-</u> tificate	CE EG-Konf.	UK CA	<u>Type Test Certific-</u> ates/Test Report	<u>Special Test Certific-</u> <u>ate</u>		
Marine / Shipping							
ABS	BUREAU VERITAS		Lloyd's Register us	PRS	RINA		
Marine / Shipping	other		Railway	Dangerous Good	Environment		
KMRS	<u>Confirmation</u>	<u>Confirmation</u>	Vibration and Shock	Transport Information	Environmental Con- firmations		
Fundle on information							
Further information	to oxit the Puscies meri	(at (see bars)					
Siemens has decided to exit the Russian market (see here). https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business							
Siemens is working on the renewal of the current EAC certificates. Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus). Information on the packaging							
https://support.industry	.siemens.com/cs/ww/en/vi						
	Information- and Downloadcenter (Catalogs, Brochures,) https://www.siemens.com/ic10						
Industry Mall (Online ordering system)							
https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT2038-3AC20							
Cax online generator							
	http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RT2038-3AC20 Service&Support (Manuals, Certificates, Characteristics, FAQs,)						
	.siemens.com/cs/ww/en/ps		•)				

6/30/2023

Subject to change without notice © Copyright Siemens http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT2038-3AC20&lang=en Characteristic: Tripping characteristics, I²t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RT2038-3AC20/char Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2038-3AC20&objecttype=14&gridview=view1

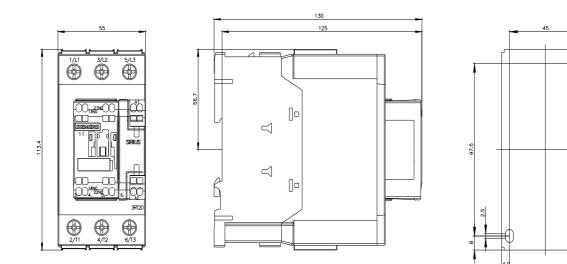

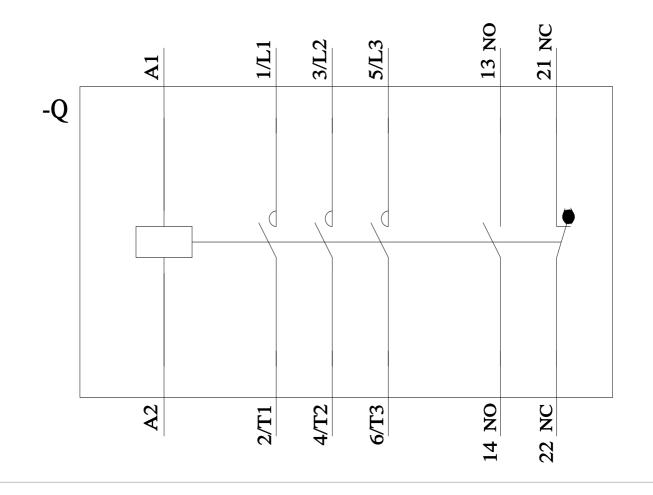

last modified:

2/10/2023 🖸