## SIEMENS

## Data sheet

## 3RT2038-3AK60



power contactor, AC-3e/AC-3, 80 A, 37 kW / 400 V, 3-pole, 110 V AC, 50 Hz / 120 V, 60 Hz, auxiliary contacts: 1 NO + 1 NC, main circuit: screw terminal, control and auxiliary circuit: spring-loaded terminal, size: S2

product brand name	SIRIUS
product designation	Power contactor
product type designation	3RT2
General technical data	
size of contactor	S2
product extension	
function module for communication	No
<ul> <li>auxiliary switch</li> </ul>	Yes
power loss [W] for rated value of the current	
<ul> <li>at AC in hot operating state</li> </ul>	17.1 W
<ul> <li>at AC in hot operating state per pole</li> </ul>	5.7 W
<ul> <li>without load current share typical</li> </ul>	18.5 W
insulation voltage	
of main circuit with degree of pollution 3 rated value	690 V
of auxiliary circuit with degree of pollution 3 rated value	690 V
surge voltage resistance	
<ul> <li>of main circuit rated value</li> </ul>	6 kV
<ul> <li>of auxiliary circuit rated value</li> </ul>	6 kV
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V
shock resistance at rectangular impulse	
• at AC	11.8g / 5 ms, 7.4g / 10 ms
shock resistance with sine pulse	
● at AC	18.5g / 5 ms, 11.6g / 10 ms
mechanical service life (operating cycles)	
<ul> <li>of contactor typical</li> </ul>	10 000 000
<ul> <li>of the contactor with added electronically optimized auxiliary switch block typical</li> </ul>	5 000 000
<ul> <li>of the contactor with added auxiliary switch block typical</li> </ul>	10 000 000
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2014
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
during operation	-25 +60 °C
during storage	-55 +80 °C
relative humidity minimum	10 %
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %
Main circuit	
number of poles for main current circuit	3

number of NO contacts for main contacts	3
operating voltage	
at AC-3 rated value maximum	690 V
at AC-3e rated value maximum	690 V
operational current	
at AC-1 at 400 V at ambient temperature 40 °C rated	90 A
value	30 A
● at AC-1	
— up to 690 V at ambient temperature 40 °C rated value	90 A
— up to 690 V at ambient temperature 60 °C rated value	80 A
• at AC-3	
- at 400 V rated value	80 A
— at 500 V rated value	80 A
— at 600 V rated value	58 A
• at AC-3e	50 A
- at 400 V rated value	80 A
— at 500 V rated value	80 A
— at 500 V rated value — at 690 V rated value	58 A
at AC-4 at 400 V rated value	55 A
	79.2 A
at AC-5a up to 690 V rated value	79.2 A 66.4 A
<ul> <li>at AC-5b up to 400 V rated value</li> <li>at AC-6a</li> </ul>	
	70 A
<ul> <li>— up to 230 V for current peak value n=20 rated value</li> <li>— up to 400 V for current peak value n=20 rated value</li> </ul>	70 A 70 A
— up to 500 V for current peak value n=20 rated value	70 A
— up to 690 V for current peak value n=20 rated value	58 A
<ul> <li>at AC-6a</li> </ul>	50 A
<ul> <li>— up to 230 V for current peak value n=30 rated value</li> </ul>	46.7 A
<ul> <li>— up to 400 V for current peak value n=30 rated value</li> </ul>	46.7 A
<ul> <li>— up to 500 V for current peak value n=30 rated value</li> </ul>	46.7 A
<ul> <li>— up to 690 V for current peak value n=30 rated value</li> </ul>	46.7 A
minimum cross-section in main circuit at maximum AC-1 rated value	35 mm²
operational current for approx. 200000 operating cycles at AC-4	
• at 400 V rated value	30 A
• at 690 V rated value	24 A
operational current	
<ul> <li>at 1 current path at DC-1</li> </ul>	
— at 24 V rated value	55 A
— at 60 V rated value	23 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
<ul> <li>with 2 current paths in series at DC-1</li> </ul>	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	45 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
<ul> <li>with 3 current paths in series at DC-1</li> </ul>	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	45 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
<ul> <li>at 1 current path at DC-3 at DC-5</li> </ul>	

— at 24 V rated value	35 A				
— at 60 V rated value	6 A				
— at 220 V rated value	1 A				
— at 440 V rated value	0.1 A				
— at 600 V rated value	0.06 A				
<ul> <li>with 2 current paths in series at DC-3 at DC-5</li> </ul>					
— at 24 V rated value	55 A				
— at 60 V rated value	55 A 45 A				
— at 110 V rated value	45 A 25 A				
— at 220 V rated value					
	5 A				
— at 440 V rated value	0.27 A				
— at 600 V rated value	0.16 A				
• with 3 current paths in series at DC-3 at DC-5					
— at 24 V rated value	55 A				
— at 60 V rated value	55 A				
— at 110 V rated value	55 A				
— at 220 V rated value	25 A				
— at 440 V rated value	0.6 A				
— at 600 V rated value	0.35 A				
operating power					
• at AC-2 at 400 V rated value	37 kW				
• at AC-3					
— at 230 V rated value	22 kW				
— at 400 V rated value	37 kW				
— at 500 V rated value	37 kW				
— at 690 V rated value	45 kW				
• at AC-3e					
- at 230 V rated value	22 kW				
— at 400 V rated value	37 kW				
— at 500 V rated value	37 kW				
— at 690 V rated value	45 kW				
operating power for approx. 200000 operating cycles at AC- 4					
at 400 V rated value	15.8 kW				
at 690 V rated value	21.8 kW				
operating apparent power at AC-6a	07.0 10/4				
	27.8 kVA				
• up to 230 V for current peak value n=20 rated value					
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> </ul>	48.4 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> </ul>	60.6 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> </ul>					
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> </ul>	60.6 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> </ul>	60.6 kVA				
up to 230 V for current peak value n=20 rated value     up to 400 V for current peak value n=20 rated value     up to 500 V for current peak value n=20 rated value     up to 690 V for current peak value n=20 rated value     operating apparent power at AC-6a	60.6 kVA 69.3 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> </ul> Operating apparent power at AC-6a <ul> <li>up to 230 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value n=30 rated value</li> <li>up to 690 V for current p</li></ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>short-time withstand current in cold operating state up to 40 °C</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC</li> </ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 ra</li></ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li></ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC</li> <li>operating freque</li></ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC-1 maximum</li> <li>at AC-</li></ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h 500 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC</li> <li>operating frequency</li> <li>at AC</li></ul>	60.6 kVA 69.3 kVA 18.6 kVA 32.3 kVA 40.4 kVA 55.8 kVA 1 298 A; Use minimum cross-section acc. to AC-1 rated value 898 A; Use minimum cross-section acc. to AC-1 rated value 640 A; Use minimum cross-section acc. to AC-1 rated value 414 A; Use minimum cross-section acc. to AC-1 rated value 333 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 700 1/h 350 1/h 500 1/h				

type of voltage of the control supply voltage	AC
control supply voltage at AC	
• at 50 Hz rated value	110 V
• at 60 Hz rated value	120 V
operating range factor control supply voltage rated value of magnet coil at AC	
• at 50 Hz	0.8 1.1
• at 60 Hz	0.8 1.1
apparent pick-up power of magnet coil at AC	
● at 50 Hz	212 VA
• at 60 Hz	188 VA
inductive power factor with closing power of the coil	
● at 50 Hz	0.69
• at 60 Hz	0.65
apparent holding power of magnet coil at AC	
• at 50 Hz	18.5 VA
• at 60 Hz	16.5 VA
inductive power factor with the holding power of the coil	
• at 50 Hz	0.36
• at 60 Hz	0.39
closing delay	
• at AC	10 80 ms
opening delay	
• at AC	10 18 ms
arcing time	10 20 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous contact	1
number of NO contacts for auxiliary contacts instantaneous contact	1
operational current at AC-12 maximum	10 A
operational current at AC-15	
• at 230 V rated value	10 A
• at 400 V rated value	3 A
• at 500 V rated value	2 A
at 690 V rated value	1 A
operational current at DC-12	
• at 24 V rated value	10 A
• at 48 V rated value	6 A
• at 60 V rated value	6 A
at 110 V rated value	3 A
at 125 V rated value	2 A
at 220 V rated value	1 A 0.15 A
at 600 V rated value	0.15 A
operational current at DC-13 • at 24 V rated value	10.4
	10 A 2 A
<ul> <li>at 48 V rated value</li> <li>at 60 V rated value</li> </ul>	2 A 2 A
at 50 V rated value     at 110 V rated value	1A
at 125 V rated value	0.9 A
at 220 V rated value	0.3 A
at 220 V rated value     at 600 V rated value	0.5 A
contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
at 480 V rated value	65 A
<ul> <li>at 600 V rated value</li> </ul>	62 A
yielded mechanical performance [hp]	62 A
	62 A
yielded mechanical performance [hp]	62 A 5 hp


— at 230 V rated value	15 hp				
• for 3-phase AC motor					
— at 200/208 V rated value	20 hp				
— at 220/230 V rated value	25 hp				
— at 460/480 V rated value	50 hp				
— at 575/600 V rated value	60 hp				
contact rating of auxiliary contacts according to UL	A600 / P600				
hort-circuit protection					
design of the fuse link					
<ul> <li>for short-circuit protection of the main circuit</li> </ul>					
— with type of coordination 1 required	gG: 250 A (690 V, 100 kA), aM: 160 A (690 V, 100 kA), BS88: 200 A (415 V, 80 kA)				
<ul> <li>— with type of assignment 2 required</li> </ul>	gG: 160A (690V,100kA), aM: 80A (690V,100kA), BS88: 125A (415V,80kA)				
<ul> <li>for short-circuit protection of the auxiliary switch required</li> </ul>	gG: 10 A (500 V, 1 kA)				
nstallation/ mounting/ dimensions					
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface				
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715				
side-by-side mounting	Yes				
height	114 mm				
width	55 mm				
depth	130 mm				
required spacing					
with side-by-side mounting					
— forwards	10 mm				
— upwards	10 mm				
— downwards	10 mm				
— at the side	0 mm				
for grounded parts	0 mm				
- forwards	10 mm				
— upwards	10 mm				
— at the side	6 mm				
— downwards	10 mm				
• for live parts	10				
— forwards	10 mm				
— upwards	10 mm				
— downwards	10 mm				
— at the side	6 mm				
connections/ Terminals					
type of electrical connection					
<ul> <li>for main current circuit</li> </ul>	screw-type terminals				
<ul> <li>for auxiliary and control circuit</li> </ul>	spring-loaded terminals				
<ul> <li>at contactor for auxiliary contacts</li> </ul>	Spring-type terminals				
<ul> <li>of magnet coil</li> </ul>	Spring-type terminals				
type of connectable conductor cross-sections for main contacts					
<ul> <li>solid or stranded</li> </ul>	2x (1 35 mm²), 1x (1 50 mm²)				
<ul> <li>finely stranded with core end processing</li> </ul>	2x (1 25 mm²), 1x (1 35 mm²)				
connectable conductor cross-section for main contacts					
<ul> <li>finely stranded with core end processing</li> </ul>	1 35 mm²				
connectable conductor cross-section for auxiliary contacts					
	0.5 2.5 mm²				
<ul> <li>solid or stranded</li> </ul>					
<ul> <li>solid or stranded</li> <li>finely stranded with core end processing</li> </ul>	0.5 1.5 mm²				
	0.5 1.5 mm² 0.5 2.5 mm²				
• finely stranded with core end processing					
<ul><li>finely stranded with core end processing</li><li>finely stranded without core end processing</li></ul>					
<ul> <li>finely stranded with core end processing</li> <li>finely stranded without core end processing</li> <li>type of connectable conductor cross-sections</li> </ul>					
<ul> <li>finely stranded with core end processing</li> <li>finely stranded without core end processing</li> <li>type of connectable conductor cross-sections</li> <li>for auxiliary contacts</li> </ul>	0.5 2.5 mm²				
<ul> <li>finely stranded with core end processing</li> <li>finely stranded without core end processing</li> <li>type of connectable conductor cross-sections</li> <li>for auxiliary contacts         <ul> <li>— solid or stranded</li> </ul> </li> </ul>	0.5 2.5 mm² 2x (0.5 2.5 mm²)				
<ul> <li>finely stranded with core end processing</li> <li>finely stranded without core end processing</li> <li>type of connectable conductor cross-sections</li> <li>for auxiliary contacts         <ul> <li>— solid or stranded</li> <li>— finely stranded with core end processing</li> </ul> </li> </ul>	0.5 2.5 mm <sup>2</sup> 2x (0.5 2.5 mm <sup>2</sup> ) 2x (0.5 1.5 mm <sup>2</sup> )				


<ul><li>for main contacts</li><li>for auxiliary cont</li></ul>			18 1 20 14			
Safety related data			20			
product function		_				
•	ccording to IEC 60947-4-1		Yes			
	•	60947-5-1	No			
. ,	• positively driven operation according to IEC 60947-5-1 B10 value with high demand rate according to SN 31920		1 000 000			
		131320	1 000 000			
	proportion of dangerous failures					
	d rate according to SN 319 Id rate according to SN 319		40 %			
			73 %			
	w demand rate according		100 FIT			
61508	interval or service life acco	raing to IEC	20 a			
	the front according to II	EC 60529	IP20			
-	he front according to IEC		finger-safe, for vertical contact from the front			
suitability for use	<b>..</b>					
<ul> <li>safety-related sv</li> </ul>	vitching OFF		Yes			
Certificates/ approvals			105			
General Product App	roval					
(SP)		<u>Confirmation</u>		KC	EAC	
EMC	Functional Safety/Safety of Ma- chinery	Declaration of (	Conformity	Test Certificates		
RCM	<u>Type Examination Cer-</u> <u>tificate</u>	CE EG-Konf.	UK CA	<u>Special Test Certific-</u> <u>ate</u>	<u>Type Test Certific-</u> ates/Test Report	
Marine / Shipping						
ABS	B U R E A U VERITAS		Llovd's Register us	PRS	RINA	
Marine / Shipping	other		Railway	Dangerous Good	Environment	
RMRS	<u>Confirmation</u>	<u>Confirmation</u>	Vibration and Shock	Transport Information	Environmental Con- firmations	
Fundle on information						
Further information						
Siemens has decided to exit the Russian market (see here). https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business						
Siemens is working on the renewal of the current EAC certificates. Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus). Information on the packaging						
https://support.industry.siemens.com/cs/ww/en/view/109813875						
Information- and Downloadcenter (Catalogs, Brochures,) https://www.siemens.com/ic10						
Industry Mall (Online						
https://mall.industry.sie	mens.com/mall/en/en/Cata	alog/product?mlfb=	<u>3RT2038-3AK60</u>			
Cax online generator		order/dofault.com	lang-on&mlfb-2DT2020 2AKee	1		
	nuals, Certificates, Chara		lang=en&mlfb=3RT2038-3AK6(	2		
	siemens.com/cs/ww/en/ps		,			
Image database (proc	Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros,)					

6/30/2023

Subject to change without notice © Copyright Siemens

http://www.automation.siemens.com/bilddb/cax\_de.aspx?mlfb=3RT2038-3AK60&lang=en Characteristic: Tripping characteristics, I<sup>2</sup>t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RT2038-3AK60/char Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2038-3AK60&objecttype=14&gridview=view1

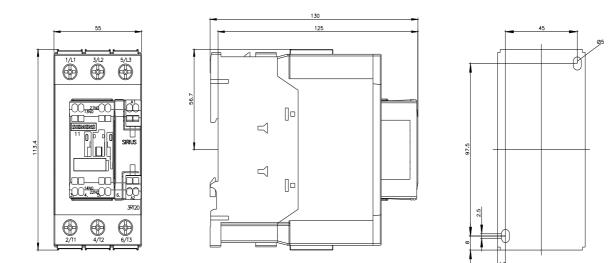

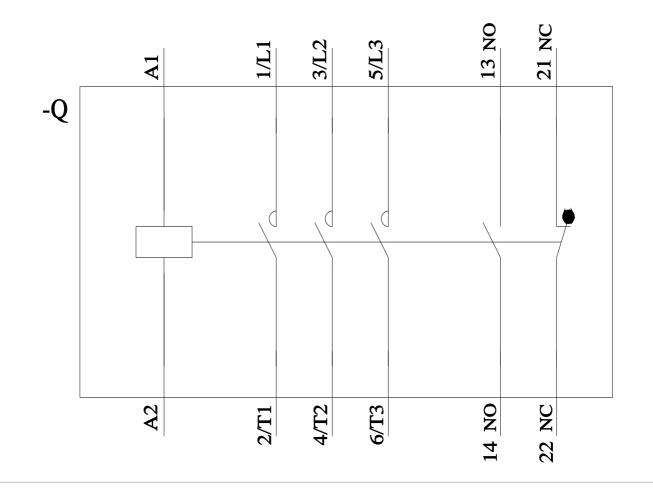

last modified:

2/10/2023 🖸