## SIEMENS

## Data sheet

## 7PV1538-1AW30



Timing relay, electronic OFF delay with control signal, 1 change-over contact 7 time ranges, 0.05 s...100 h 12-240 V AC/DC with LED, Screw terminal


proved by				
product brand name	SIRIUS			
product designation	timing relay			
design of the product	OFF delay with control signal			
product type designation	7PV15			
General technical data				
product component semi-conductor output	No			
product extension required remote control	No			
product extension optional remote control	No			
insulation voltage for overvoltage category III according to IEC 60664 with degree of pollution 3 rated value	300 V			
test voltage for isolation test	2.2 kV			
degree of pollution	2			
surge voltage resistance rated value	4 000 V			
test voltage for surge voltage test	4 800 V			
protection class IP	IP20			
shock resistance according to IEC 60068-2-27	11g / 15 ms			
vibration resistance according to IEC 60068-2-6	10 55 Hz: 0.35 mm			
mechanical service life (switching cycles) typical	10 000 000			
electrical endurance (switching cycles) at AC-15 at 230 V typical	100 000			
adjustable time	0.05 s 100 h			
relative setting accuracy relating to full-scale value	5 %; +/-			
minimum ON period	35 ms			
recovery time	500 ms			
reference code according to IEC 81346-2	К			
relative repeat accuracy	2 %; +/-			
influence of the surrounding temperature	2% in complete temperature range for the set duration			
power supply influence	2% in complete voltage range for the set duration			
Substance Prohibitance (Date)	05/01/2012			
Control circuit/ Control				
type of voltage of the control supply voltage	AC/DC			
control supply voltage 1 at AC				
• at 50 Hz	12 240 V			
• at 60 Hz	12 240 V			
control supply voltage frequency 1	50 60 Hz			
control supply voltage 1				
• at DC	12 240 V			
operating range factor control supply voltage rated value at DC				
<ul> <li>initial value</li> </ul>	0.85			
<ul> <li>full-scale value</li> </ul>	1.1			
operating range factor control supply voltage rated				


value at AC at 50 Hz	
• initial value	0.85
full-scale value	1.1
operating range factor control supply voltage rated value at AC at 60 Hz	
initial value	0.85
full-scale value	1.1
Switching Function	
switching function	
• ON-delay	No
<ul> <li>ON-delay/instantaneous contact</li> </ul>	No
passing make contact	No
passing make contact/instantaneous contact	No
OFF delay     switching function	NO
<ul> <li>flashing symmetrically with interval start/instantaneous</li> </ul>	No
<ul> <li>flashing symmetrically with interval start</li> </ul>	No
<ul> <li>flashing symmetrically with pulse start/instantaneous</li> </ul>	No
<ul> <li>flashing symmetrically with pulse start</li> </ul>	No
flashing asymmetrically with interval start	No
flashing asymmetrically with pulse start	No
switching function	Ne
star-delta circuit with delay time	No
star-delta circuit	No
<ul> <li>switching function with control signal</li> <li>additive ON-delay</li> </ul>	No
passing break contact	No
<ul> <li>passing break contact/instantaneous</li> </ul>	No
• OFF delay	Yes
OFF delay/instantaneous	No
<ul> <li>pulse delayed</li> </ul>	No
<ul> <li>pulse delayed/instantaneous</li> </ul>	No
<ul> <li>pulse-shaping</li> </ul>	No
<ul> <li>pulse-shaping/instantaneous</li> </ul>	No
additive ON-delay/instantaneous	No
ON-delay/OFF-delay	No
ON-delay/OFF-delay/instantaneous	No
passing make contact	No
<ul> <li>passing make contact/instantaneous contact</li> <li>switching function of interval relay with control signal</li> </ul>	No
<ul> <li>retrotriggerable with deactivated control signal/instantaneous contact</li> </ul>	No
<ul> <li>retrotriggerable with switched-on control signal</li> </ul>	No
<ul> <li>retrotriggerable with switched-on control</li> </ul>	No
signal/instantaneous contact	
retriggerable with deactivated control signal	No
design of the control terminal non-floating	Yes
Short-circuit protection	
design of the fuse link for short-circuit protection of the auxiliary switch required	fuse gL/gG: 4 A
Auxiliary circuit	4a5a02
material of switching contacts number of NC contacts	AgSnO2
delayed switching	0
instantaneous contact	0
number of NO contacts	
delayed switching	0
instantaneous contact	0
number of CO contacts	
<ul> <li>delayed switching</li> </ul>	1
<ul> <li>instantaneous contact</li> </ul>	0
operational current of auxiliary contacts at AC-15	

	2.4
• maximum	3 A 2 A
● at 24 V ● at 250 V	3 A 3 A
• at 250 V operational current of auxiliary contacts as NC contact at AC-15	3 A
• at 24 V	3 A
• at 250 V	3 A
operational current of auxiliary contacts as NO	
contact at AC-15	
• at 24 V	3 A
• at 250 V	3 A
operational current of auxiliary contacts at DC-13	1 0.01
operational current of auxiliary contacts at DC-13	
• at 24 V	1 A
• at 125 V	0.22 A
• at 250 V	0.1 A
operating frequency with 3RT2 contactor maximum	5 000 1/h
contact reliability of auxiliary contacts	one incorrect switching operation of 100 million switching operations (17 V, 5 mA)
contact rating of auxiliary contacts according to UL	R150 / B300
switching capacity current with inductive load	0.01 3 A
Inputs/ Outputs	
product function	
<ul> <li>at the relay outputs switchover delayed/without</li> </ul>	No
delay	
non-volatile	No
Electromagnetic compatibility	
EMC immunity according to IEC 61812-1	EN 61000-6-2
conducted interference	
<ul> <li>due to burst according to IEC 61000-4-4</li> </ul>	2 kV network connection / 1 kV control connection
<ul> <li>due to conductor-earth surge according to IEC</li> </ul>	2 kV
61000-4-5	
<ul> <li>due to conductor-conductor surge according to IEC 61000-4-5</li> </ul>	1 kV
field-based interference according to IEC 61000-4-3	10 V/m
electrostatic discharge according to IEC 61000-4-2	4 kV contact discharge / 8 kV air discharge
Safety related data	
type of insulation	Basic insulation
category according to EN 954-1	none
Connections/ Terminals	
product component removable terminal for auxiliary	No
and control circuit	
type of electrical connection for auxiliary and control circuit	screw-type terminals
type of connectable conductor cross-sections	
• solid	1x (0.2 2.5 mm <sup>2</sup> )
<ul> <li>finely stranded with core end processing</li> </ul>	1x (0.25 1.5 mm <sup>2</sup> )
<ul> <li>finely stranded without core end processing</li> <li>at AWC cables calid</li> </ul>	1x (0.2 1.5 mm <sup>2</sup> )
at AWG cables solid	1x (24 14)
<ul> <li>at AWG cables stranded</li> <li>connectable conductor cross-section</li> </ul>	1x (24 14)
solid	0.2 2.5 m²
<ul> <li>finely stranded with core end processing</li> </ul>	0.25 1.5 m <sup>2</sup>
<ul> <li>finely stranded with core end processing</li> <li>finely stranded without core end processing</li> </ul>	0.2 1.5 m <sup>2</sup>
AWG number as coded connectable conductor cross	
section	
• solid	24 14
stranded	24 14
Installation/ mounting/ dimensions	
mounting position	any
fastening method	snap-on fastening on 35 mm DIN rail
height	90 mm
width	17.5 mm
depth	66.7 mm
required spacing	


<ul> <li>with side-by-side</li> </ul>	de mounting				
— forwards		(	) mm		
- backward	S	(	) mm		
— upwards		(	) mm		
- downward	ls	(	) mm		
— at the side	,	(	) mm		
<ul> <li>for grounded particular</li> </ul>					
— forwards		(	) mm		
— backward	0		) mm		
— upwards	5		) mm		
			) mm		
— at the side					
— downward	IS	(	0 mm		
<ul> <li>for live parts</li> </ul>					
— forwards			) mm		
— backward	S	(	) mm		
— upwards		(	) mm		
— downward	ls	(	) mm		
— at the side	9	(	) mm		
Ambient conditions					
	height above sea level	maximum	2 000 m		
ambient temperatur	-		2 000 111		
<ul> <li>during operatio</li> </ul>			-25 +55 °C		
	11		-25 +55 °C -40 +70 °C		
during storage					
during transport			40 +70 °C		
relative humidity duri			15 85 %		
Certificates/ approva	ls				
General Product A	oproval			EMC	Declaration of
General Product A	oproval			EMC	Declaration of Conformity
General Product A		•		EMC	Conformity
General Product A	oproval Confirmation	Ē	ror	ЕМС	Conformity
General Product A		(h	FAL	ЕМС	
General Product Ap		(U)	EAC	EMC RCM	Conformity
General Product Ap		(UL) UL	EAC	EMC RCM	Conformity
General Product Ap		(UL) UL	ERC		Conformity
CCC		(Ju u	ERC	EMC RCM	Conformity
Ccc Declaration of		UL UL	EAC	EMC RCM	Conformity
CCC	Confirmation	UL	EAC	EMC RCM	Conformity
Ccc Declaration of	Confirmation Test Certificates		EAC	RCM	Conformity
Ccc Declaration of	Confirmation Confirmation Test Certificates Type Test Certific-	UL UL Other Confirmation	ERE	RCM	Conformity
CCC	Confirmation Test Certificates		ERF Environmental Con- firmations	RCM	Conformity
CCC	Confirmation Confirmation Test Certificates Type Test Certific-			RCM	Conformity
Declaration of Conformity	Confirmation Confirmation Test Certificates Type Test Certific-			RCM	Conformity
Declaration of Conformity	Confirmation Confirmation Test Certificates Type Test Certific-			RCM	Conformity
Declaration of Conformity	Confirmation Confirmation Test Certificates Type Test Certific-			RCM	Conformity
Declaration of Conformity	Confirmation Confirmation Test Certificates Type Test Certific-			RCM	Conformity
Declaration of Conformity Ceck EG-Konf.	Confirmation Test Certificates <u>Type Test Certificates</u> <u>tes/Test Report</u>	Confirmation		RCM	Conformity
Ccc Declaration of Conformity CEG-Konf. Further information	Confirmation Test Certificates Type Test Certific- ates/Test Report ownloadcenter (Catalo	Confirmation		RCM	Conformity
Declaration of Conformity CCC EG-Konf. Further information Information- and Doc https://www.siemens.	Confirmation Test Certificates Type Test Certific- ates/Test Report wwnloadcenter (Catalo	Confirmation		RCM	Conformity
Declaration of Conformity Cece EG-Konf.	Confirmation Test Certificates Type Test Certific- ates/Test Report wwnloadcenter (Catalo	<u>Confirmation</u> gs, Brochures,)	firmations	RCM	Conformity
Declaration of Conformity Eurther information Information- and Do https://www.siemens. Industry Mall (Onlin https://mall.industry.si	Confirmation Test Certificates Type Test Certific- ates/Test Report winloadcenter (Catalo com/ic10 e ordering system) iemens.com/mall/en/en	<u>Confirmation</u> gs, Brochures,)	firmations	RCM	Conformity
Declaration of Conformity Eurther information Information- and Do https://www.siemens. Industry Mall (Onlin https://mall.industry.si Cax online generato	Confirmation Test Certificates Type Test Certific- ates/Test Report wunloadcenter (Catalo com/ic10 e ordering system) iemens.com/mall/en/en or	<u>Confirmation</u> gs, Brochures,) /Catalog/product?n	firmations	RCM	Conformity
Declaration of Conformity	Confirmation Test Certificates Type Test Certificates, Certi	<u>Confirmation</u> gs, Brochures,) / <u>Catalog/product?n</u> <u>CAXorder/default.a</u> Characteristics, F <i>A</i>	firmations http=7PV1538-1AW30 http://ang=en&mtfb=7PV1 http://angs)	RCM	Conformity
Declaration of Conformity	Confirmation Test Certificates Type Test Certific- ates/Test Report wnloadcenter (Catalo com/ic10 e ordering system) iemens.com/mall/en/en or tition.siemens.com/WW// lanuals, Certificates, C ry.siemens.com/cs/ww/	Confirmation gs, Brochures,) /Catalog/product?n CAXorder/default.a Characteristics, FA en/ps/7PV1538-1A	firmations http=7PV1538-1AW30 http://ang=en&mtfb=7PV1 http://angs)	538-1AW30	Conformity

http://www.automation.siemens.com/bilddb/cax\_de.aspx?mlfb=7PV1538-1AW30&lang=en Characteristic: Derating https://support.industry.siemens.com/cs/ww/en/ps/7PV1538-1AW30/manual

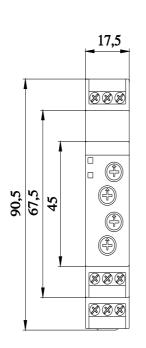

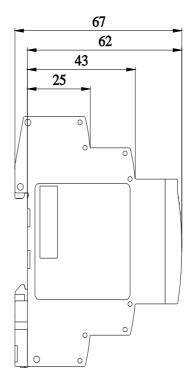

Alle Bemassungswerte sind in Millimeter (mm) angegeben All dimensions are in millimeters (mm)

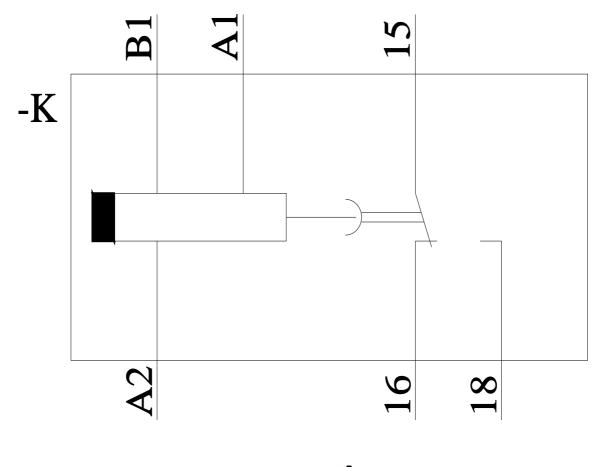

11/21/2022 🖸