


| LTR | ECO No. | REVISION | DR | CK | AP | AP | DATE |
|-----|---------|-----------------------|----|----|----|----|-----------|
| Α | NONE | ENGINEERING RELEASE | JK | | | | 10/29/07 |
| В | 8705 | LIDDATE BODDED & LOCO | 10 | | | | 1.IUNF 09 |



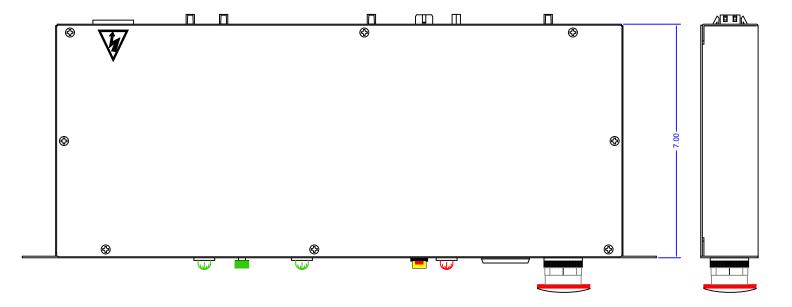



NOTES:

1. RACK MOUNTED STEEL CHASSIS, BLACK MEDIUM TEXTURE

19.00" WIDE 1.72 " HIGH

7.00 " DEEP

CHASSIS SUPPORT BRACKETS ARE REQUIRED

2. INPUT: 100 - 240 VAC 12A SINGLE PHASE 50/60HZ. INLET: IEC 60320 C14 INLET
POWER CORD: NOT INCLUDED

3. CONTROL SWITCHES: 1 GREEN BUTTON (ON) 1 BLACK BUTTON (OFF)

1 BLACK BUTTON (EPO TEST) (OPERATES ALARM HORN AND EPO LIGHT ONLY) 1 YELLOW BUTTON (ALARM SILENT)

4. INDICATOR LIGHTS: FIVE 1 GREEN, FOR CIRCUIT BREAKER STATUS OF REMOTE PDU (ON WHEN UNIT IS CONNECTED TO 100 - 240VAC)

1 GREEN, ON WHEN REMOTE UNIT IS SWITCHED ON.

1 RED, ON WHEN EMERGENCY POWER OFF IS ACTIVATED.

1 GREEN, ON WHEN EPO IS IN RESET CONDITION (EPO OFF).

1 RED, ON WHEN ALARM SILENT IS ACTIVATED.

5. REMOTE I/O SWITCHING CONNECTORS: 6

MATE WITH AMP # 1-480305-0 CONNECTOR, WITH AMP # 60620-1 PINS J1 & J2: REMOTE ON/OFF AND EPO OUTPUT COMMAND TO REMOTE POWER CONTROLLER (PIN 1 TO 3 FOR REMOTE ON/OFF AND PIN 2 TO 3 FOR EMERGENCY POWER OFF).

J3: CONNECT PINS 1 AND 2 FOR EPO (12VDC CIRCUIT)

J4: CONNECT PINS 1 AND 2 TO SILENCE EPO ALARM (12VDC CIRCUIT J5-J6: SPDT CONTACTS TO CONTROL AUXILIARY EQUIPMENT.

> 1 NORMALLY CLOSED 2 COMMON 3 NORMALLY OPEN

- 6. HOUR METER: 6 DIGIT: ON WHEN REMOTE UNIT IS ON RESOLUTION: 1/10TH OF AN HOUR
- 7. ALARM HORN: 90dB AT 4IN. ON WHEN EPO IS ACTIVATED.
- 8. EMERGENCY OFF SWITCH: RED MUSHROOM PUSHBUTTON SWITCH. PUSH TO ACTIVATE EMERGENCY POWER OFF. TURN KNOB TO RESET EPO. RESET INDICATOR AND REMOTES J5 AND J
- 9. EACH UNIT SUPPLIED WITH 8-FOOT CABLE WITH CONNECTOR FOR J2 ON ONE END AND 3-PIN MALE AMP CONNECTOR ON THE OTHER END
- 10. U.L. RECOGNIZED COMPONENTS WHERE APPLICABLE
- 11. RoHS COMPLIANT PER DIRECTIVE 2002/95/EC WITH APPLICABLE EXEMPTIONS

HONEYWELL APPROVAL DATE

| | | F | | | | Pho | 3200 S. Susan Street, Santa Ana, CA ne (714) 540-4229 Fax (714) 641-9062 | |
|---|------|--------|-------------------------------------|--------------|-----------|-----------------|---|------|
| THE INFORMATION AND DESIGN DISCLOSED HEREIN WAS ORIGIN. BY AND IS THE PROPERTY OF EATON CORPORATION. EATON CORPORATION RESERVES ALL PATENT, PROPRIETARY, DESIGN, MANUFACTURING. REPRODUCTION. USE AND SALE RIGHTS THER | | | RANCES: | TITLE | | | ENGINEERING DRAWIN RCP2500-3609 ASSY 3 | |
| AND TO ANY ARTICLE DISCLOSED THEREIN, EXCEPT TO THE EXTE | | .XXX | | DRAWN BY | : JK | | DWG FILENAME:RCP_2500_3608B_ME.DWG | |
| RIGHTS ARE EXPRESSLY GRANTED TO OTHERS. THE FOREGOING NOT APPLY TO VENDOR PROPRIETARY PARTS. COPYRIGH 20 09 EATON C | a no | St.010 | OTHERWISE SPECIFIED ODE 70513 | SCALE 1:1 | SIZE D | SHEET 1 OF 1 | RCP_2500_3609B_ | ME E |