DATASHEET - DILER-40(220V50HZ,240V60HZ)



Contactor relay, 4N/O, AC

DILER-40(220V50HZ,240V60HZ) Part no.

Catalog No. 051758 Eaton Catalog No. XTRM10A40B



Delivery program

belivery program			
Product range			DILER Mini-contactors
Application			Contactor relays
Description			with interlocked opposing contacts
Connection technique			Screw terminals
Rated operational current			
Conventional free air thermal current, 1 pole			
Open			
at 50 °C	$I_{th} = I_e$	Α	10
AC-15			
220 V 230 V 240 V	I _e	Α	6
380 V 400 V 415 V	I _e	Α	3
Contacts			
N/O = Normally open			4 N/O
Contact sequence			A1 13 23 33 43 A2 14 24 34 44
Code number and version of combination			
Distinctive number			40 E
For use with			DILE
Actuating voltage			220 V 50 Hz, 240 V 60 Hz
Voltage AC/DC			AC operation
Instructions			Contact numbers to EN 50011 Coil terminal markings to EN 50005

Technical data

General			
Standards			IEC/EN 60947, EN 60947-5-1, VDE 0660, UL, CSA
Lifespan, mechanical			
AC operated	Operations	x 10 ⁶	10
Maximum operating frequency	Operations/h		9000
Climatic proofing			Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature			
Open		°C	-25 - +50
Enclosed		°C	- 25 - 40
Mounting position			
Mounting position			As required, except vertical with terminals A1/A2 at the bottom
Mounting position			

Mechanical shock resistance (IEC/EN 60068-2-27)			
Half-sinusoidal shock, 10 ms			
Basic unit with auxiliary contact module		g	
N/O contact		g	10
N/C contact		g	8
Degree of Protection			IP20
Protection against direct contact when actuated from front (EN 50274)			Finger and back-of-hand proof
Weight			
AC operated		kg	0.17
Terminal capacities		mm^2	
Screw terminals			
Solid		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 2.5)
Flexible with ferrule		mm ²	1 x (0.75 - 1.5) 2 x (0.75 - 1.5)
Solid or stranded		AWG	18 - 14 1 x (18 - 14) 2 x (18 - 14)
Stripping length		mm	8
Terminal screw			M3.5
Pozidriv screwdriver		Size	2
Standard screwdriver		mm	0.8 x 5.5 1 x 6
Max. tightening torque		Nm	1.2
Contacts			w.
Interlocked opposing contacts to ZH 1/457, including auxiliary contact module		V 40	Yes
Rated impulse withstand voltage	U _{imp}	V AC	6000
Overvoltage category/pollution degree			III/3
Rated insulation voltage	Ui	V AC	690
Rated operational voltage	U _e	V AC	600
Safe isolation to EN 61140			
between coil and auxiliary contacts		V AC	300
between the auxiliary contacts		V AC	300
Rated operational current		Α	
Conventional free air thermal current, 1 pole			
Open			
at 50 °C	$I_{th} = I_e$	Α	10
AC-15			
220 V 230 V 240 V	le	Α	6
380 V 400 V 415 V	I _e	Α	3
500 V	l _e	Α	1.5
DC current			
Notes			Switch-on and switch-off conditions based on DC-13, time constant as specified.
DC L/R ≦ 15 ms			
Contacts in series:		Α	
1	24 V	Α	2.5
2	60 V	A	2.5
3	110 V	A	1.5
3	220 V	A	0.5
Control circuit reliability	Failure rate	λ	$<10^{-8}$, $<$ one failure at 100 million operations (at U _e = 24 V DC, U _{min} = 17 V, I _{min} = 5.4 mA)
Short-circuit rating without welding			
Maximum overcurrent protective device			
220 V 230 V 240 V		PKZM0	4
380 V 400 V 415 V		PKZM0	4
Short-circuit protection maximum fuse			
500 V		A gG/gL	6

500 V		A fast	10
Current heat loss at I _{th}			
AC operated		W	1.1
Magnet systems			
Voltage tolerance			
AC operated			
Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz	Pick-up	x U _c	0.8 - 1.1
Dual-frequency coil 50/60 Hz	Pick-up	x U _c	0.85 - 1.1
Power consumption			
AC operation			
Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz	Pick-up	VA	25
Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz	Sealing	VA	4.6
Single-voltage coil 50 Hz and dual-voltage coil 50 Hz, 60 Hz	Sealing	W	1.3
duty factor		% DF	100
Changeover time at 100 $\%$ U _S (recommended value)			
AC operated closing delay		ms	14 - 21
AC operated N/O contact opening delay		ms	8 - 18
AC operated With auxiliary contact module Max. closing delay		ms	45
Rating data for approved types			
Auxiliary contacts			
Pilot Duty			
AC operated			A600
DC operated			P300
General Use			
AC		٧	600
AC		Α	10
DC		V	250

0.5

Design verification as per IEC/EN 61439

DC

Dooigii vormoution do por 120, 211 or 100			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	6
Heat dissipation per pole, current-dependent	P _{vid}	W	0.4
Equipment heat dissipation, current-dependent	P _{vid}	W	0
Static heat dissipation, non-current-dependent	P _{vs}	W	1.8
Heat dissipation capacity	P _{diss}	W	0
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	50
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.


10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 6.0

Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Contactor relay (ec@ss8.1-27-37-10-01 [AAB716011]) Rated control supply voltage Us at AC 50HZ Rated control supply voltage Us at AC 60HZ Rated control supply voltage Us at AC 60HZ V 240 - 240 Rated control supply voltage Us at DC Voltage type for actuating Rated operation current Ie , 400 V Rated operation current Ie , 400 V Connection type auxiliary circuit Mounting method Interface No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading With LED indication No Number of auxiliary contacts as change-over contact					
Rated control supply voltage Us at AC 50HZ Rated control supply voltage Us at AC 60HZ Rated control supply voltage Us at AC 60HZ V 240 - 240 V 0 - 0 Rated control supply voltage Us at DC Voltage type for actuating Rated operation current le , 400 V Rated operation current le , 400 V Connection type auxiliary circuit Mounting method Mounting method Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading Nith LED indication No Number of auxiliary contacts as change-over contact O Consection No No No No No No No No No	Low-voltage industrial components (EG000017) / Contactor relay (EC000196)				
Rated control supply voltage Us at AC 60HZ Active Control supply voltage Us at DC Voltage type for actuating Rated operation current le , 400 V Connection type auxiliary circuit Mounting method Interface No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally open contact, delayed switching Number of auxiliary contacts as normally open contact, leading Nith LED indication No Number of auxiliary contacts as change-over contact O No Number of auxiliary contacts as change-over contact O No No No No No No No No No	Electric engineering, automation, process control engineering / Low-voltage switch technology / Contactor (LV) / Contactor relay (ecl@ss8.1-27-37-10-01 [AAB716011])				
Rated control supply voltage Us at DC Voltage type for actuating AC Rated operation current le , 400 V A 3 Connection type auxiliary circuit Mounting method Interface No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading With LED indication Number of auxiliary contacts as change-over contact No O Number of auxiliary contacts as change-over contact No O No O O O O O O O O O O O O O	Rated control supply voltage Us at AC 50HZ	V	2	220 - 220	
Voltage type for actuating Rated operation current le , 400 V Rated operation current le , 400 V Rated operation current le , 400 V Connection type auxiliary circuit Mounting method Mounting method Interface No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as change-over contact	Rated control supply voltage Us at AC 60HZ	V	2	240 - 240	
Rated operation current le , 400 V Connection type auxiliary circuit Mounting method Interface	Rated control supply voltage Us at DC	V	(0 - 0	
Connection type auxiliary circuit Mounting method Interface No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as change-over contact No No Number of auxiliary contacts as change-over contact O	Voltage type for actuating		,	AC	
Mounting method Interface No Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as change-over contact No No Number of auxiliary contacts as change-over contact No	Rated operation current le , 400 V	А	3	3	
No Number of auxiliary contacts as normally closed contact No Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as change-over contact No Number of auxiliary contacts as change-over contact No	Connection type auxiliary circuit		!	Screw connection	
Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as normally closed contact, delayed switching Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as change-over contact No Number of auxiliary contacts as change-over contact O	Mounting method		I	DIN-rail/screw	
Number of auxiliary contacts as normally open contact 4 Number of auxiliary contacts as normally closed contact, delayed switching 0 Number of auxiliary contacts as normally open contact, leading No Number of auxiliary contacts as change-over contact 0	Interface		I	No	
Number of auxiliary contacts as normally closed contact, delayed switching 0 Number of auxiliary contacts as normally open contact, leading 0 With LED indication No Number of auxiliary contacts as change-over contact 0	Number of auxiliary contacts as normally closed contact		(0	
Number of auxiliary contacts as normally open contact, leading 0 With LED indication No Number of auxiliary contacts as change-over contact 0	Number of auxiliary contacts as normally open contact		4	4	
With LED indication No Number of auxiliary contacts as change-over contact 0	Number of auxiliary contacts as normally closed contact, delayed switching		(0	
Number of auxiliary contacts as change-over contact 0	Number of auxiliary contacts as normally open contact, leading		(0	
, ,	With LED indication		ı	No	
Manual operation possible No	Number of auxiliary contacts as change-over contact		(0	
	Manual operation possible		I	No	


Approvals


• •	
Product Standards	IEC/EN 60947-4-1; UL 508; CSA-C22.2 No. 14-05; CE marking
UL File No.	E29184
UL Category Control No.	NKCR
CSA File No.	012528
CSA Class No.	3211-03
North America Certification	UL listed, CSA certified
Specially designed for North America	No

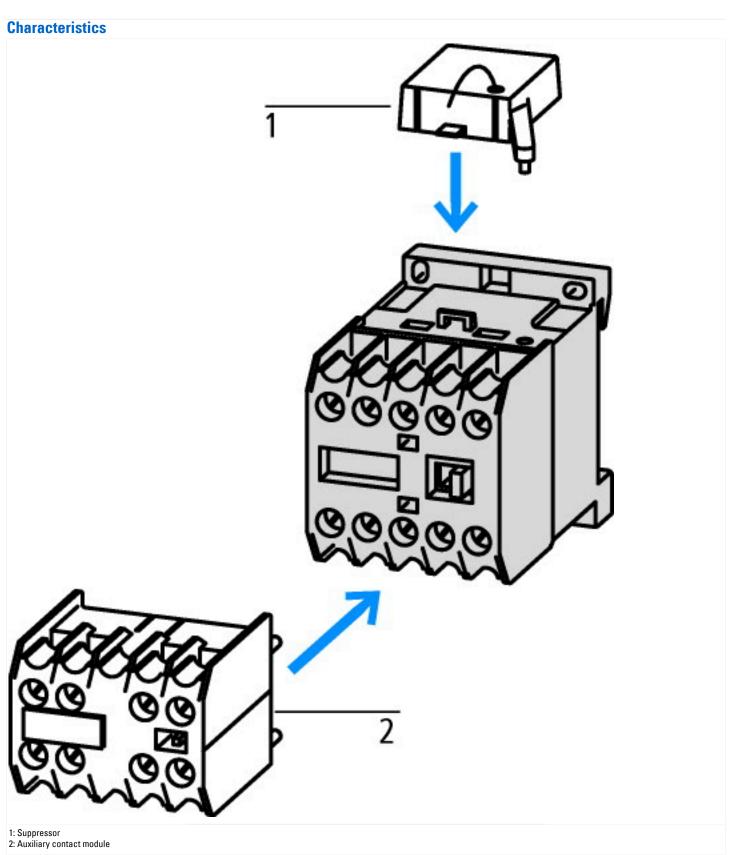

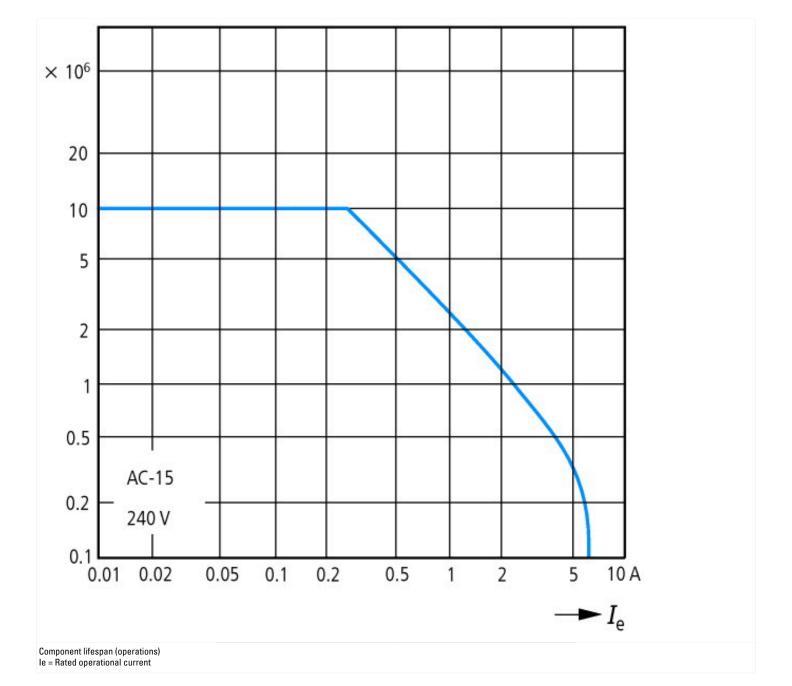

Dimensions

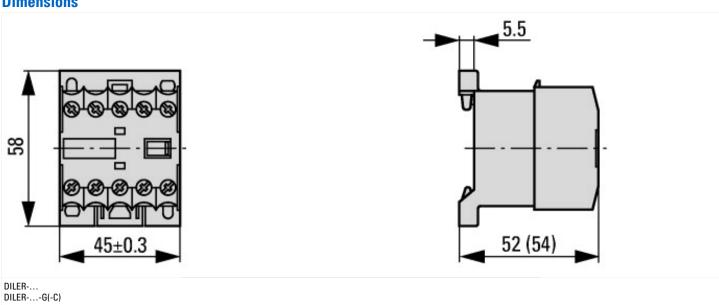

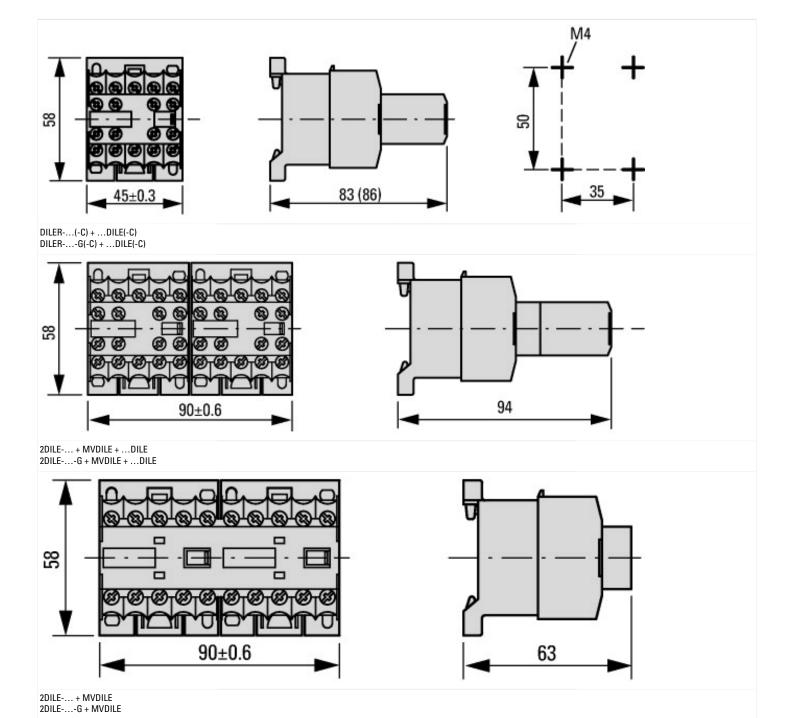

Additional product information (links)

IL03407009Z (AWA2100-0882) Mini contactor relay

IL03407009Z (AWA2100-0882) Mini contactor relay

ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03407009Z2018_04.pdf